

Data Sheet

FTC Floor Heating Sensor

Application

FTC is used for flow temperature control of floor heating and radiator heating systems.

FTC is a self-acting thermostatic sensor, which can be combined with 2-way valve bodies, types RA-N and RA-C.

The water temperature is measured by a surface sensor, which is easily mounted on the pipe with a strip (enclosed with the product). The snap-lock connector of the sensor element secures a firm connection to the valve.



Features:

- Closes on rising sensor temperature.
- Temperature range: 15 to 50° C or 35 to 70° C.
- Valve can be mounted on flow or return pipe.
- Sized for pressure PN 10.

Ordering

Sensor type	Setting range	Capillary length	Max. ambient temp.	Code no.	
FTC	35 - 70° C	0 - 2 m	65° C	013G5080	
FTC	15 - 50° C	0 - 2 m	65° C	013G5081	

Walana la ada	Conne	ection	I. *	Code no.	
Valve body	Inlet	Outlet	k _{vs} *		
RA-N 10, straight	G 3/8	R 3/8	0.65 m³/h	013G0032	
RA-N 15, straight	G 1/2	R 1/2	0.90 m³/h	013G0034	
RA-N 20, straight	G 3/4	R 3/4	1.40 m³/h	013G0036	
RA-C 15, straight	G 3/4 A	G 3/4 A	1.20 m³/h	013G3094	
RA-C 20, straight	G 1 A	G 1 A	3.30 m³/h	013G3096	

^{*} k_V -value stated at setting N. Xp between 2 K and 8 K.

Technical Specifications

FTC with valve body	k _V m ³ /h* at a P-band of K			Max. pressure			Max. temperature		
	2	4	6	8	PN	Δр	Test	Flow	Ambient
RA-N 10	0.18	0.34	0.46	0.56	10 bar	0.6 bar	16 bar	120° C	65° C
RA-N 15	0.22	0.44	0.62	0.73					
RA-N 20	0.32	0.62	0.88	1.04					
RA-C 15	0.40	0.71	0.90	1.03					
RA-C 20	1.06	1.94	2.45	2.75					


^{*} k_V -value stated at setting N. Xp between 2 K and 8 K.

VDUKE302 © Danfoss 05/2015 1


Data Sheet

FTC Floor Heating Sensor

System Principles

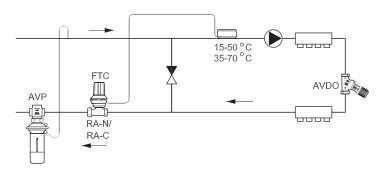


Floor Heating System

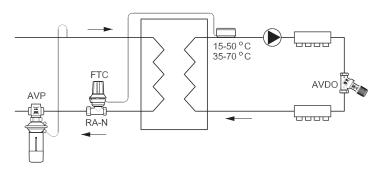

Heat Exchanger in Radiator Heating or Floor Heating System


Design



- 1. Socket
- 2. Bellows
- 3. Setting dial
- 4. Reference mark
- 5. Limiter
- 6. "Reset" spring
- 7. Spindle
- 8. Safety spring
- 9. Capillary tube
- 10. Console
- 11. Remote sensor housing


Dimensions

2




FTC Floor Heating Sensor


Capacity, FTC with RA-N

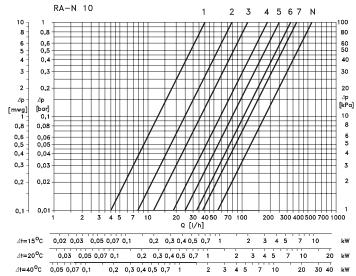

FTC sensor with RA-N 10 valve

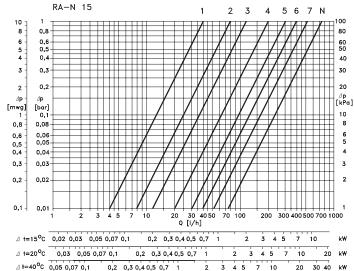


FTC sensor with RA-N 15 valve




FTC sensor with RA-N 20 valve



Capacity, FTC with RA-C

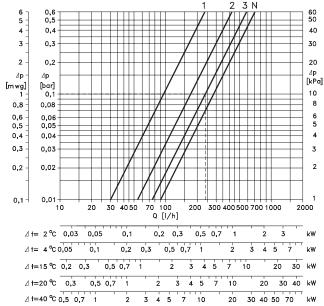

FTC sensor with RA-C 15 valve

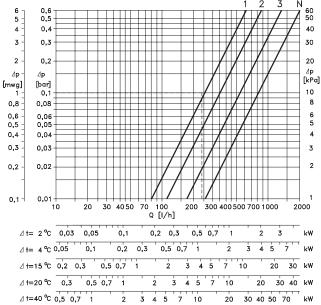

FTC sensor with RA-C 20 valve

Danfoss can accept no responsibility for possible errors in catalogues, brochures and other printed material. Danfoss reserves the right to alter its products without notice. This also applies to products already on order provided that such alterations can be made without subsequential changes being necessary in specifications already agreed.

All trademarks in this material are property of the respective companies. Danfoss and the Danfoss logotype are trademarks of Danfoss A/S. All rights reserved.

05/2015

4 VDUKE302 © Danfoss